
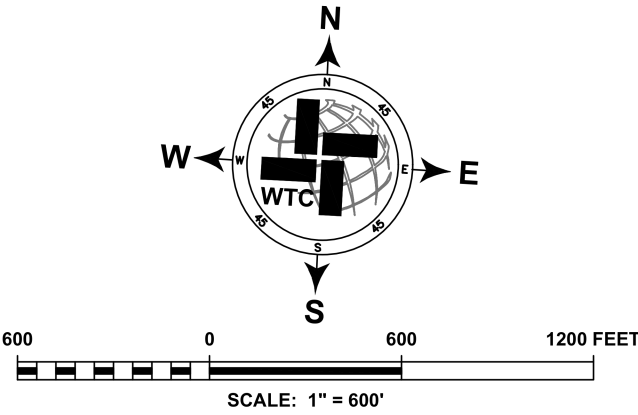


1- 500,000 TANK (27R, 30' HIGH)
1- 1,500,000 TANK (46R, 30' HIGH)

CRITICAL VELOCITY (PG 187 PE-HANDBOOK) = 4-7ft/S
PIPE SELECTED: DIPS HDPE PIPE PE4710 DR 11 (200 psi)

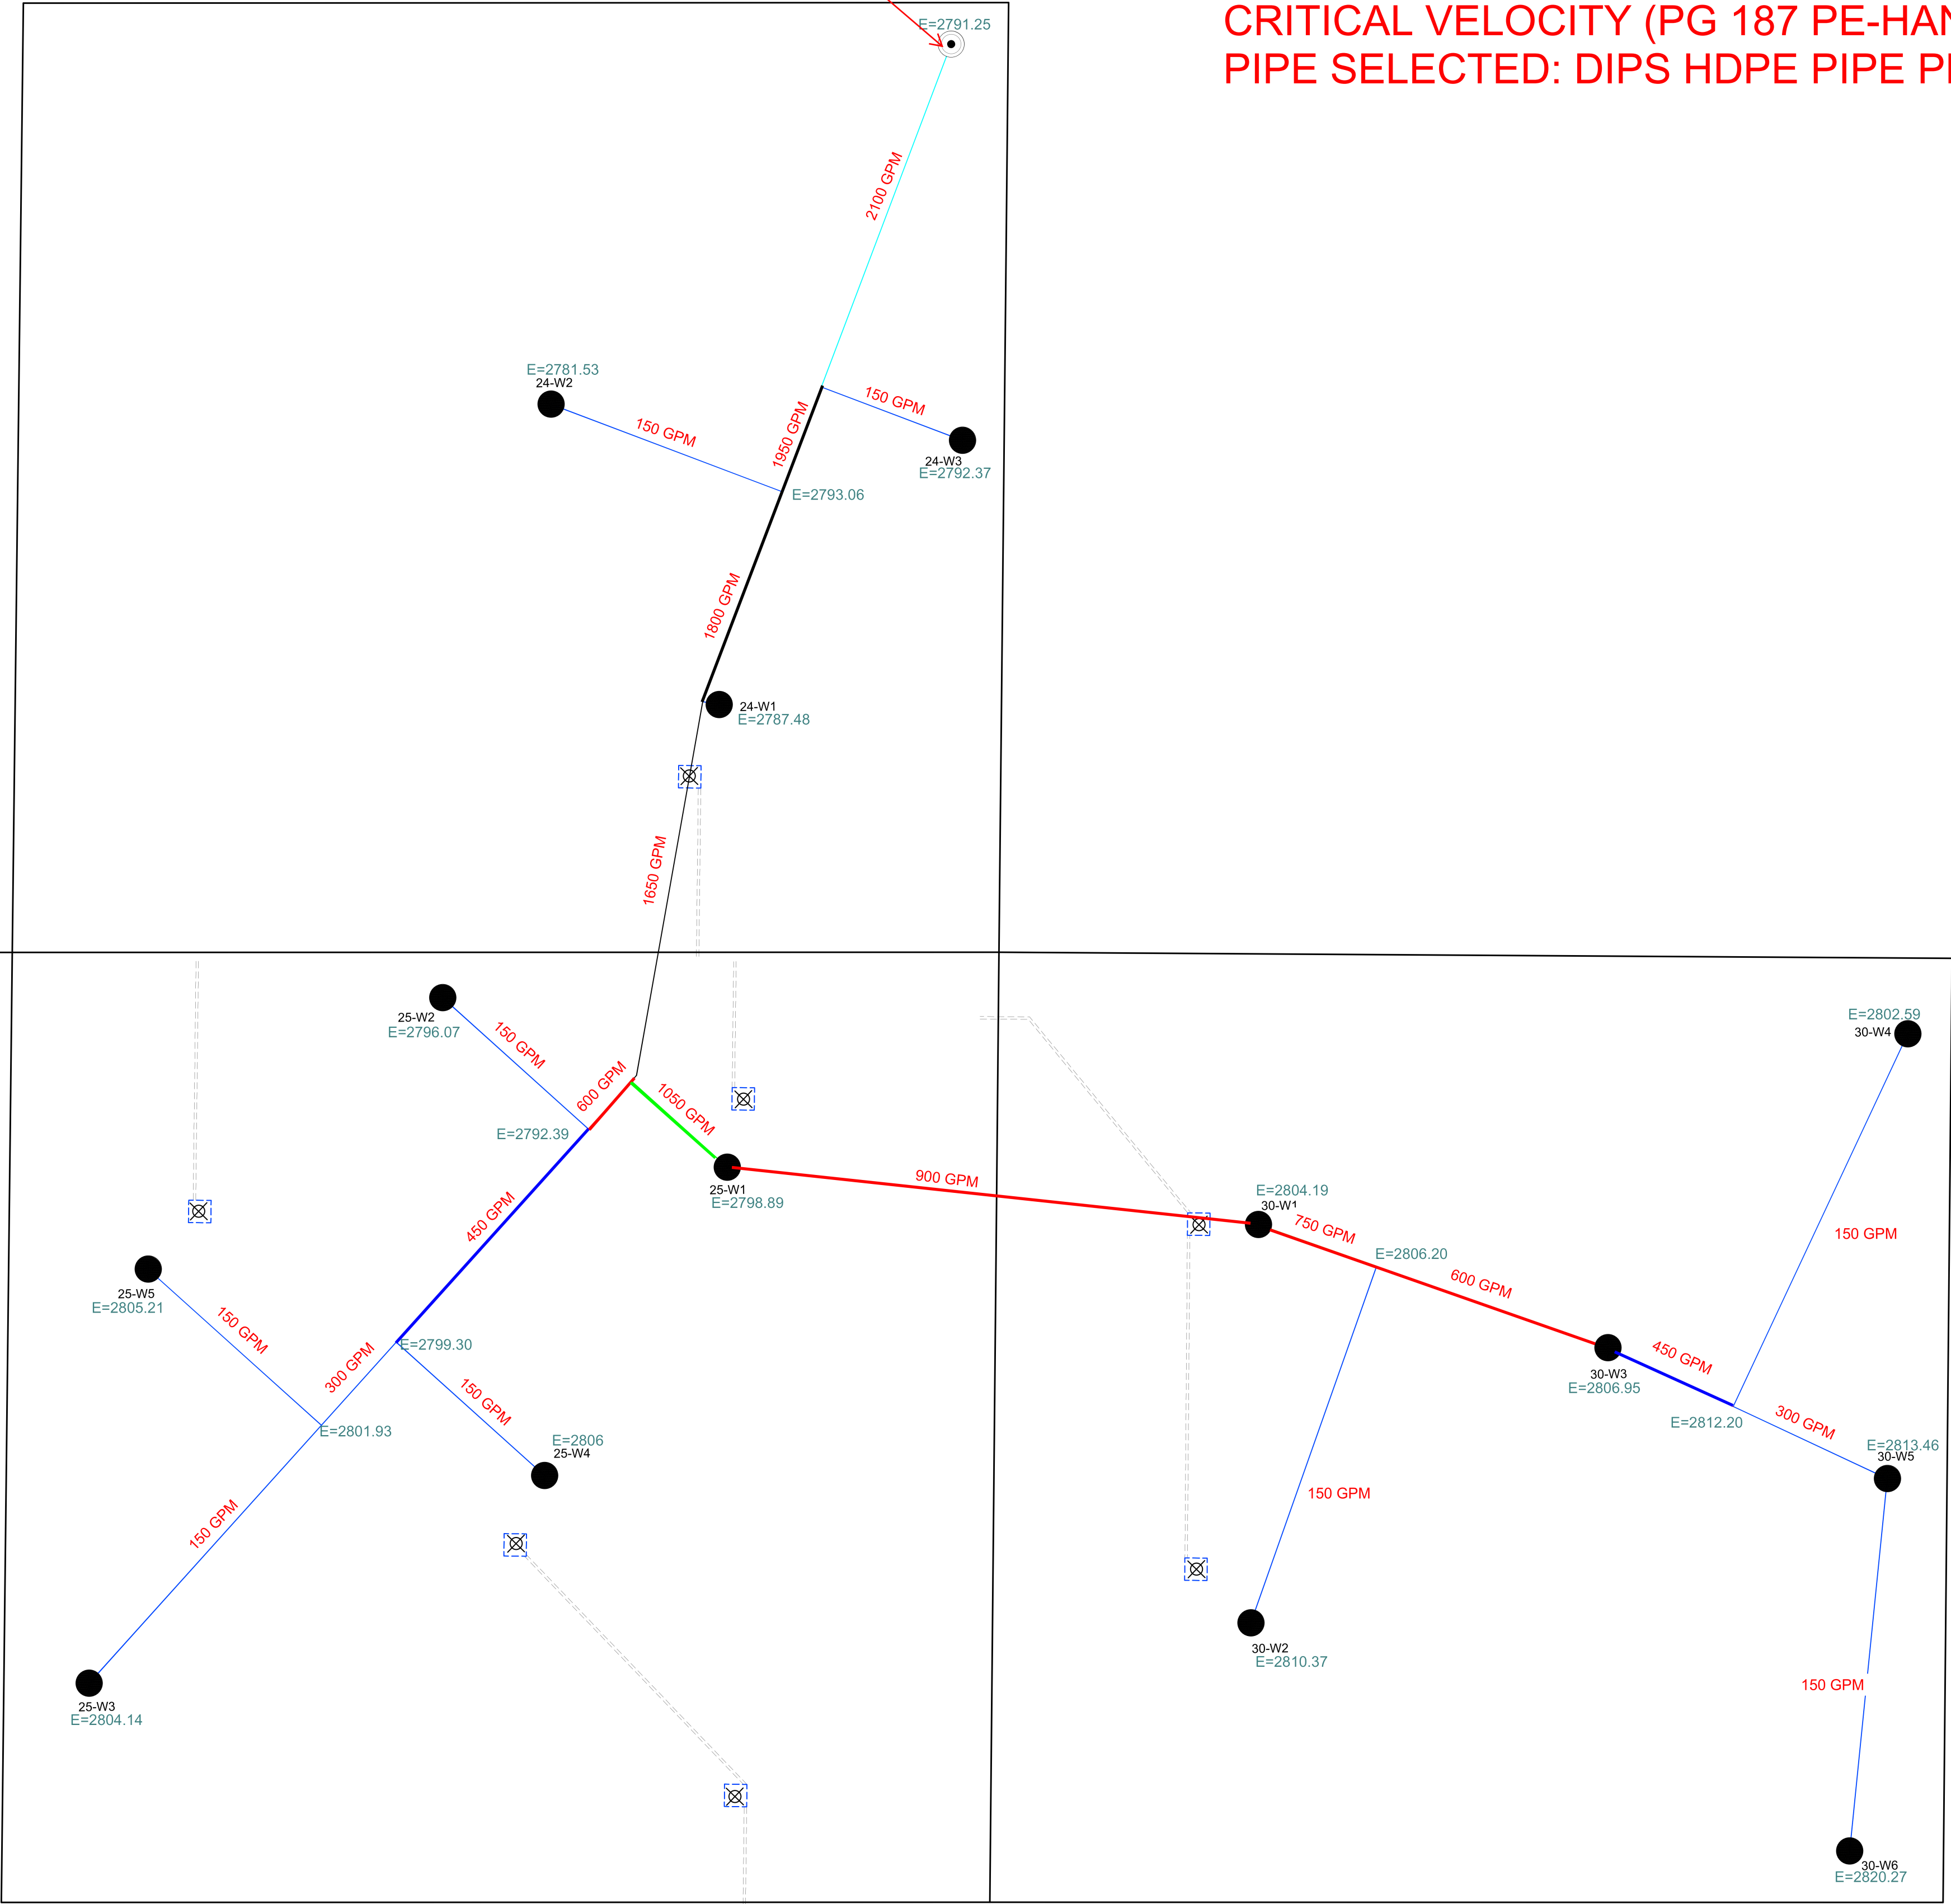

CE 3372 Wellfield and Collector Layout

LOCATIONS OF UNDERGROUND UTILITIES ARE APPROXIMATE AND MAY NOT INCLUDE ALL UNDERGROUND UTILITIES PRESENT. CONTRACTOR SHALL VERIFY THE LOCATIONS OF ALL UTILITY CROSSINGS BEFORE EXCAVATION OF ROADWAY.

CONTRACTOR SHALL NOTIFY PROPERTY OWNERS AND RESIDENTS A MINIMUM OF 48 HOURS IN ADVANCE OF CONSTRUCTION ACTIVITIES ON OR IN THE VICINITY OF THEIR PROPERTY.

Before You Dig Anywhere In Texas
STOP! CALL 1-800-245-4545

TOLL-FREE OSHA RULE 1926.651
REQUIRES PREVIOUS
NOTIFICATION TEXAS ONE CALL
SYSTEM

LEGEND

- PROPOSED PROD. WELL
- ⊗ PROPOSED TANK
- MONITOR WELL
- PROPOSED 6" WL
- PROPOSED 8" WL
- PROPOSED 10" WL
- PROPOSED 12" WL
- PROPOSED 14" WL

REVISION DESCRIPTION	REVISION	DATE

CITY OF PECOS REEVES COUNTY, TEXAS					
WELL FILL DEVELOPEMENT					
DESIGN	DRAWN	DATE	PROJECT NO.	SCALE	PAGE:
				N/A	